


QPRC

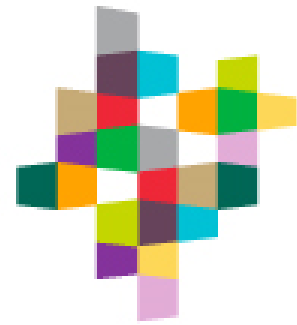

**QUEANBEYAN PALERANG
REGIONAL COUNCIL**

**DEVELOPMENT CONSTRUCTION
SPECIFICATION**

CQC

**QUALITY CONTROL
REQUIREMENTS**

VERSION 1 – DECEMBER 2018

Amendment Record for this Specification Part

This Specification is Council's edition of the AUS-SPEC generic specification part and includes Council's primary amendments.

Details are provided below outlining the clauses amended from the Council edition of this AUS-SPEC Specification Part. The clause numbering and context of each clause are preserved. New clauses are added towards the rear of the specification part as special requirements clauses. Project specific additional script is shown in the specification as italic font.

The amendment code indicated below is 'A' for additional script 'M' for modification to script and 'O' for omission of script. An additional code 'P' is included when the amendment is project specific.

Amendment Sequence No.	Key Topic addressed in amendment	Clause No.	Amendment Code	Author Initials	Amendment Date
VERSION 1	Special accreditation by PCA	CQC3.5	A	KD	30/06/10
	Blasting added to table	CQC-B1	A		
	Blasting added to table	CQC-B2	A		
	Test methods added	CQC-B6	A		
	Test methods and additional requirements added	CQC-B15	A		
	PVC-M, PVC-O and steel pipe added	CQC-B17	A		
	Polypropylene (PP) and steel pipe added	CQC-B18	A		
	Annexure added	CQC-C	A		
	Annexure added	CQC-D	A		
	References to QPRC Updated	Various	M	EE	5/06/18

**SPECIFICATION CQC
QUALITY CONTROL REQUIREMENTS – VERSION 1**

CLAUSE	CONTENTS	PAGE
GENERAL		1
CQC1	SCOPE.....	1
CQC2	LOTS.....	1
CQC3	SAMPLING AND TESTING	1
CQC4	SURVEYING	2
CQC5	RECORDS	2
CQC6	CERTIFICATION.....	3
CQC7	AUDIT.....	3
MEASUREMENT AND PAYMENT		4
CQC8	PAY ITEMS	4
ANNEXURES		
CQC-A	RANDOM SAMPLING	
CQC-B	MAXIMUM LOT SIZES AND MINIMUM TEST FREQUENCIES	
CQC-C	CONSTRUCTION CERTIFICATION REPORT	
CQC-D	ENGINEER'S CONSTRUCTION CERTIFICATION	

SPECIFICATION CQC
QUALITY CONTROL REQUIREMENTS – VERSION 1

GENERAL

CQC1 SCOPE

1. This Specification covers the requirements for the quality control testing and survey by the Contractor; including the minimum test frequencies to be employed to demonstrate conformance to the requirements of the technical specifications.

Testing and Survey

CQC2 LOTS

1. All items of work shall be subdivided into lots. Each lot shall be given a unique lot number.

2. Lots shall be chosen by the Contractor but shall be within the limits given in Annexure CQC-B. In general, the size of the lot shall not exceed one day's output for each work process designated for lot testing.

Lot Size

3. The lot numbers shall be used as identifiers on all surveys and test results.

Lot Numbers

4. The Contractor shall determine the bounds of each lot before sampling and shall identify each lot clearly.

Lot Identification

5. The boundaries of a lot may be changed if subsequent events cause the original lot to be no longer essentially homogeneous.

Lot Boundaries

6. The lot identification system and sample numbering system shall allow test results to be positively identified with material incorporated in the works.

Test Results

CQC3 SAMPLING AND TESTING

1. All compliance inspections and tests shall be based on lots.

Lots

2. The maximum lot sizes and minimum testing frequencies are listed in the Annexures to the relevant Specifications and/or in Annexure CQC-B to this Specification. Where no minimum frequency of testing, or maximum lot size is stated in the Specification, the Contractor shall nominate appropriate frequencies for the Superintendent's approval.

**Lot Sizes
Frequency of Testing**

3. Sampling shall not be restricted to locations dimensioned or otherwise defined for setting out the Works in the Drawings or Specification, but shall be undertaken in a random or unbiased manner, as approved by the Superintendent, at any location within the Works to demonstrate its compliance with the Specification.

Sampling Locations

4. Where Test Methods are nominated in the Technical Specifications, sampling and testing shall be carried out by a NATA registered laboratory accredited for those test methods and sampling procedures. Sampling shall be conducted by personnel from the NATA registered laboratory which has been accredited for that sampling procedure and shall be supervised by the approved signatory from that laboratory. Test results shall be reported on NATA endorsed test documentation which shall include a statement by the approved signatory certifying that the correct sampling procedures have been followed.

Sampling and Testing

QUALITY CONTROL REQUIREMENTS – QUEANBEYAN-PALERANG

5. In special circumstances the Principal Certifying Authority may accredit a laboratory that is not NATA registered for specific tests or inspection procedures. **Special Accreditation**
6. The Contractor shall reinstate all core holes, test holes, excavations and any other disturbance resulting from any testing activity. The reinstatement shall be to a standard which is at least equal to the specified requirements for the particular work. **Reinstatement**
7. Random sampling techniques shall be used for each lot for the control of compaction of each continuous layer of earthworks, flexible pavement and asphalt. Annexure CQC-A defines the method to be used for determining test locations of random sampling in each lot. **Random Sampling**
8. For quality control of processes other than compaction of layers of earthworks, flexible pavement and asphalt, the sampling locations will be proposed by the Contractor and will require the approval of the Superintendent. **Sampling Locations**
9. In all cases the samples shall be each considered to be representative of the lot and all test results will be required to meet the appropriate tolerances for the lot. **All Test Results to Meet Tolerances**

CQC4 SURVEYING

1. Surveying Control shall include all measurement, calculation and record procedures necessary to: **Requirements**
- (a) set out the Works
 - (b) verify conformance to the Drawings and Specification in relation to dimensions, tolerances and three dimensional position
 - (c) determine lengths, areas or volumes of materials or products, where required for measurement of work.
2. The Contractor shall appoint qualified surveyors who are eligible for membership of the Institution of Surveyors, Australia or the Institution of Engineering and Mining Surveyors, Australia to supervise and take responsibility for all Surveying Control. **Surveyor Qualifications**
3. The procedures and equipment used must be capable of attaining the tolerances nominated in the Specification. **Equipment**
4. Sampling for conformance verification purposes shall not be restricted to the locations used to set out the Works. **Sampling Locations**
5. The Contractor shall submit a Survey Conformance Report to the Superintendent for each lot or component where design levels, position and/or tolerances have been specified. The Survey Conformance Report shall show 'specified vs. actual' for position (defined by co-ordinates or chainage and offset), level and tolerance as appropriate and shall be certified by the qualified surveyor responsible for the verification survey. **Conformance Report**

CQC5 RECORDS

1. Conformance records shall be stored and maintained such that they are readily retrievable and in facilities that provide a suitable environment to minimise deterioration or damage and to prevent loss. **Storage**

2. The Contractor shall submit all conformance records to the Superintendent for inspection and approval. If requested by the Superintendent, the Contractor shall provide copies of the records or test results at no cost to the Principal.

**Copies of
Records
Contractor's
Cost**

CQC6 CERTIFICATION

1. The Superintendent shall present to Queanbeyan Palerang Regional Council, a Certification Report for Construction Works which shall indicate the conformance of the works with the technical specifications, and will comprise the test results certificate set out in Annexure CQC-C, the Developer's Engineer's Certificate set out in Annexure CQC-D, and the Works as Executed documentation.

**Certification
Report**

2. The Certification Report for Construction Works shall be required at the completion of the construction works, and prior to the endorsement of any Subdivision Certificate, or in the case of building works which involve civil engineering construction, prior to the endorsement of the Occupation Certificate.

**Certificate
Submission**

3. The Developer's Engineer shall be a Civil Engineer, suitably experienced and qualified so as to be accepted as a member of the Institution of Engineers, Australia, or a suitably experienced Registered Surveyor. The Developer's Engineer shall submit a certificate indicating that the works have been constructed in accordance with the approved drawings and technical specifications.

**Developer's
Engineer**

CQC7 AUDIT

1. Council shall have the right of audit of all processes and documents related to the project construction. The Contractor, Superintendent and Accredited Certifier shall provide Council's Officers all reasonable assistance in inspecting records of construction and testing procedures.

Assistance

2. In order to provide for such audit, access to the premises of the Contractor, Superintendent and Accredited Certifier will be provided to Council on a 24 hour notice basis.

Access

MEASUREMENT AND PAYMENT

CQC8 PAY ITEMS

1. Payment shall be made for all activities associated with testing, survey and supplier's documentation required to demonstrate conformance to the specification requirements.
2. Cost adjustments, if applicable, will apply the same as to any other Pay Item in the Schedule.

Pay Item QCP1 QUALITY VERIFICATION AND CONTROL

1. The Lump Sum for this item shall include all costs for inspections, conformance surveys and testing required to verify that all aspects of the work under the Contract comply with the quality requirements of the Contract, including the ongoing compilation of quality records.
2. Payments shall be made pro rata on the monthly value of work done.

**ANNEXURE CQC-A
RANDOM SAMPLING**

CQC-A1 GENERAL

1. Random sampling of test locations shall be used to control relative compaction of each layer of:
 - (i) earthworks
 - (ii) selected material zone
 - (iii) flexible pavement
 - (iv) asphalt
 - (v)
 - (vi)
 - (vii)

which are generally rectangular in area.

CQC-A2 SAMPLING RATES

1. The number of samples (n) per lot shall be as indicated in the specific Specification Parts which are summarised in the Sub-Annexure to this Quality Requirements Specification.

CQC-A3 RANDOM SAMPLING LOCATIONS

1. Sampling locations within a lot for the control of relative compaction shall be determined as follows:
 - (i) Representing the lot as a rectangle, sub-divide the lot lengthwise into equi-area sub-lots in accordance with the number of samples selected (n).
 - (ii) Establish six grid lines within the lot, as illustrated in Figure CQC-A2;
 - (iii) Throw a die to select a number between 1 and 6. This determines which grid line to use for the sample location in sub-lot 1;
 - (iv) Throw die to select a group (1-6) in Table CQC-A1;
 - (v) Throw die twice to select two random numbers (between 1 and 6) for row and column in Table CQC-A1 and obtain random fraction R;
 - (vi) Length co-ordinate for sample location in Sub-lot 1 = RL/n ;
 - (vii) For sample location in next sub-lot:-
Add L/n to previous length co-ordinate.
Add 1 (on a cycle of 6) to previous grid line.

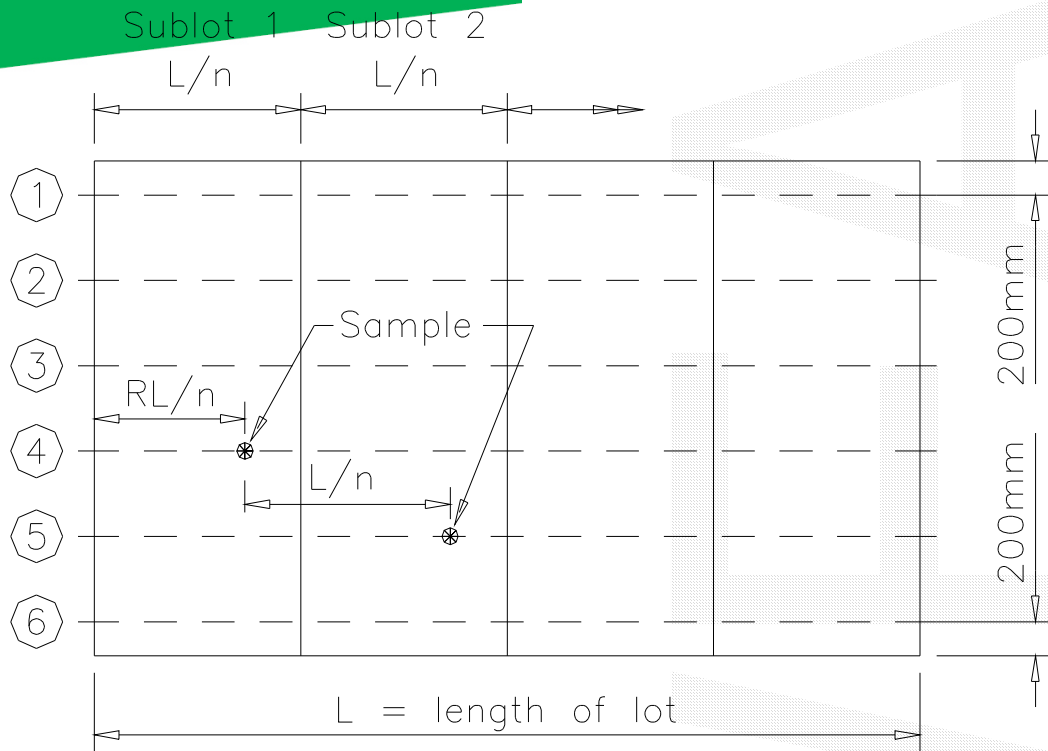


Figure CQC-A2 Sampling Locations for Rectangular Lot

QUALITY CONTROL REQUIREMENTS – QUEANBEYAN-PALERANG

GROUP	ROW	COLUMN					
		(1)	(2)	(3)	(4)	(5)	(6)
(1)	(1)	0.78178	0.45467	0.00347	0.27296	0.00020	0.36517
	(2)	0.59678	0.67931	0.25434	0.59054	0.32444	0.41504
	(3)	0.14464	0.17269	0.61154	0.18291	0.83242	0.50776
	(4)	0.89010	0.44764	0.07451	0.20428	0.49513	0.91440
	(5)	0.91941	0.47726	0.33160	0.30670	0.65114	0.36852
	(6)	0.51085	0.38148	0.22169	0.66578	0.67050	0.69559
(2)	(1)	0.81891	0.48626	0.88892	0.82994	0.16941	0.81528
	(2)	0.37410	0.60232	0.12070	0.79017	0.32981	0.34908
	(3)	0.45921	0.15648	0.58052	0.37413	0.08124	0.97145
	(4)	0.86614	0.94719	0.78872	0.91972	0.45149	0.15107
	(5)	0.26590	0.41140	0.95477	0.81267	0.24018	0.07324
	(6)	0.95205	0.39438	0.73697	0.59427	0.71146	0.00575
(3)	(1)	0.18694	0.36502	0.17828	0.84312	0.57003	0.58583
	(2)	0.91211	0.86936	0.43030	0.27672	0.47393	0.10342
	(3)	0.80714	0.34295	0.00775	0.90855	0.33368	0.21842
	(4)	0.67579	0.92686	0.18005	0.00645	0.11256	0.05278
	(5)	0.03184	0.69876	0.16676	0.43346	0.86992	0.03275
	(6)	0.15623	0.02905	0.72763	0.19095	0.80847	0.39729
(4)	(1)	0.72109	0.17970	0.22505	0.35561	0.98935	0.27818
	(2)	0.37348	0.19381	0.43331	0.75033	0.99963	0.42232
	(3)	0.12129	0.32386	0.56705	0.87165	0.84460	0.92955
	(4)	0.54948	0.08844	0.47061	0.78419	0.18731	0.93485
	(5)	0.15097	0.44967	0.48759	0.84161	0.19212	0.05146
	(6)	0.32360	0.66850	0.99382	0.94050	0.96449	0.96217
(5)	(1)	0.68091	0.54191	0.10910	0.94237	0.23161	0.15167
	(2)	0.97121	0.83626	0.70896	0.45296	0.69475	0.11264
	(3)	0.19723	0.98260	0.57429	0.94789	0.64457	0.20809
	(4)	0.84036	0.14095	0.29451	0.40256	0.34521	0.64924
	(5)	0.97500	0.98056	0.82276	0.97130	0.77329	0.89855
	(6)	0.83244	0.30828	0.06882	0.68471	0.71081	0.91649
(6)	(1)	0.75892	0.29685	0.70044	0.91238	0.53356	0.45239
	(2)	0.13229	0.19701	0.36074	0.32254	0.62045	0.26691
	(3)	0.34789	0.22179	0.91891	0.87651	0.91011	0.97469
	(4)	0.97211	0.68943	0.12831	0.50006	0.20793	0.61151
	(5)	0.24954	0.17809	0.56093	0.51524	0.69135	0.68967
	(6)	0.10062	0.11852	0.47089	0.64765	0.44644	0.35548

Table CQC-A1 - Table of Random Fractions

ANNEXURE CQC- B
MAXIMUM LOT SIZES AND MINIMUM TEST FREQUENCIES

GENERAL

1. The maximum lot sizes and minimum test frequencies are separately specified for all major activities covered by the Technical Specifications as listed hereunder.
2. The requirements applicable to this Contract are identified with an asterisk indicating that only these details are attached in this Annexure.
3. Where material/product quality certification can be obtained from the supplier, tests listed per contract/separable part need not be repeated.

Contents of Annexure CQC-B

Item	Sub-Annexure	Required (*) for this Contract	Reference Specification	Sub-Annexure Heading
1	B1		C213	Earthworks
2	B2		C220 C221 C222 C223 C224	Stormwater Drainage - General Stormwater Drainage - Pipe Culverts, Box Culverts, Open Drains, Kerb & Gutter, Drainage Structures Drainage Structures Open Drains including Kerb and Gutter
3	B3		C230 C231 C232 C233	Subsurface Drainage - General Subsurface Drainage Pavement Drains Drainage Mats
4	B4		C241	Stabilisation
5	B5		C242	Flexible Pavements
6	B6		C244	Sprayed Bituminous Surfacing
7	B7		C245	Asphaltic Concrete
8	B8		C247 C248	Ready Mixed Concrete Production and Supply Plain or Reinforced Concrete Base
9	B9		C247	Mass Concrete Subbase
10	B10		C248	Plain or Reinforced Concrete Base
11	B11		C255	Bituminous Microsurfacing
12	B12		C254	Segmental Paving
13	B13		C271	Minor Concrete Works
14	B14		C261	Pavement Markings
15	B15		C262	Signposting
16	B16		C273	Landscaping
17	B17		C401	Water Reticulation
18	B18		C402	Sewerage System

**Sub-Annexure B1
EARTHWORKS (Specification C213)**

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Stripping Topsoil	Surface Levels	10,000m ²	1 Cross Section per 25m	Survey
Excavation	Geometry	10,000m ²	1 Cross Section per 25m	Survey
Floor of Cuttings	Material Quality - CBR	5,000m ²	1 per 1,000m ² *	AS1289.6.1.1
	Compaction	10,000m ²	1 per 500m ²	AS1289.5.4.1 or AS.1289.5.7.1
Blasting	Ground vibration / noise control	1 day's blasting	Continuous monitoring	
Foundation for Embankments	Compaction	5,000m ²	1 per 500m ²	AS1289.5.4.1 or AS. 1289.5.7.1
Embankments - General	Geometry	One layer 10,000m ²	1 Cross Section per 25m	Survey
	Material Quality - CBR	One layer 5,000m ²	1 per 800m ³	AS1289.6.1.1
	Compaction/Moisture Content	One layer 5,000m ²	1 per 250m ³	AS1289.5.1.1 AS1289.5.4.1 AS1289.5.7.1
Road Carriageway Embankments - Select Zone	Geometry	One layer 10,000m ²	1 Cross Section per 25m	Survey
	Material Quality - Maximum Particle Size	10,000m ²	1 per 1,000m ³ *	AS1289.6.1.1
	- CBR	10,000m ²	1 per 500m ³ *	
	Compaction/Moisture Content	One layer 5,000m ²	1 per 250m ³	AS1289.5.1.1, AS1289.5.4.1 AS1289.5.7.1
Fill Adjacent to Structures: Bridges, Retaining Walls and Cast-in-Situ Culverts	Material Quality			
	- Maximum Particle Size	1 Structure	1 per 200m ³ *	AS1289.3.3.1
	- Plasticity Index	1 Structure	1 per 200m ³ *	
	Compaction/Moisture Content	1 Structure	1 per layer	AS1289.5.1.1, AS1289.5.4.1 AS1289.5.7.1

* Note: or part thereof, per lot.

Sub-Annexure B2

STORMWATER DRAINAGE - PIPE CULVERTS, BOX CULVERTS, OPEN DRAINS INCLUDING KERB & GUTTER, DRAINAGE STRUCTURES (Specifications C220, C221, C222, C223, C224)

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Supply of Precast Units	Precast Quality - Suppliers documentary evidence and certification	1 batch	1 per type/size/class per batch	
Siting and Excavation	Geometry	1 drainage line/structure	1 per drainage line/structure	Survey
Excavation by Blasting	Peak particle velocity	1 drainage line / structure	1 per drainage line / structure	Measure
Foundation	Compaction	1 drainage line/structure	1 per 20 lin m *	AS1289.5.4.1
Material surrounding Steel Structures	Material Quality - pH/Electrical Resistivity	1 drainage line/structure	1 per material	AS1289.4.3.1 AS1289.4.4.1
Bedding	Material Quality - Particle Size Distribution	1 contract	1 per 200m ³ *	AS1141.11
	Compaction/Moisture Content	1 drainage line/structure	1 per layer, per 20 lin m	AS1289.5.7.1, AS1289.5.4.1
Concrete Bedding or Lining	Geometry		1 Cross Section per 25m	Survey and 3m Straight Edge
Installation of Precast Units	Geometry	1 drainage line/structure	1 per drainage line/structure	Survey
Selected Backfill	Material Quality - Maximum Particle Size	1 contract	1 per 100m ³ *	AS1289.3.3.1 AS1289.5.7.1, AS1289.5.4.1
	- Plasticity Index	1 contract	1 per 100m ³ *	
	Compaction/Moisture Content	1 drainage line/structure	1 per 2 layers per 50m ²	
Rock Fill for Gabions/ Wire Mattresses	Material Quality: - Wet Strength	1 contract	1 per contract	AS1141.22
	- Wet/Dry Strength Variation	1 contract	1 per contract	AS1141.22
Kerb and Gutter	Geometry		1 Cross Section per 25m	Survey and 3m Straight Edge

* Note: or part thereof, per lot.

Sub-Annexure B3
SUBSURFACE DRAINAGE (Specifications C230, C231, C232, C233)

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD	
Material Supply	Material Quality - Supplier's documentary evidence and certification of:				
	Pipe	1 contract/size	1 per type/size		
	Filter Material				
	- Grading (Type A, B, C, D)	1 contract/size	1 per type	AS1141.11	
	- Coefficient of Permeability (Type B)	1 contract/size	1 per type	AS1289.E5.1 ASTM-D2434-68	
	- Grading Variation after Treatment (Type B)	1 contract/size	1 per type	AS1141.11	
	- Wet Strength (Type C, D)	1 contract/size	1 per type	AS1141.22	
- 10% Fines Wet/Dry (Type C, D)	1 contract/size	1 per type	AS1141.22		
	Geotextile	1 contract	1 per type		
Excavation - Trench Base	Line and Grade	1 drainage line	1 per drainage line	Survey	
	Compaction	1 drainage line	1 per 200 lin m*	AS1289.5.4.1	
Bedding and Backfill					
	- Filter Material	Compaction	1 drainage line	1 per drainage line	AS1289.5.4.1
	- Selected Backfill	Compaction	1 drainage line	1 per 200 lin m*	AS1289.5.4.1
- Earth Backfill	Compaction	1 drainage line	1 per 200 lin m*	AS1289.5.4.1	
Drainage Mat	Geometry	2000m ²	1 Cross Section per 25m	Survey	

* Note: or part thereof, per lot

**Sub-Annexure B4
STABILISATION (Specification C241)**

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Material Supply	Material Quality - Supplier's documentary evidence and certification of:			
	- Cement	1 contract	1 per 100t	AS3972
	- Quicklime			
	· Available Lime (CaO content)	1 contract	1 per 100t	AS3583.12
	· Slaking Rate	1 contract	1 per 100t	T432
	· Particle Size Distribution	1 contract	1 per contract	AS1141.11
	- Hydrated Lime			
	· Available Lime (CaOH ₂)	1 contract	1 per 100t	AS3583.12
	· Residue on Sieving	1 contract	1 per contract	AS3583.14
	- Ground Blast Furnace Slag	1 contract	1 per month	AS3583.2
- Flyash	1 contract	1 per month	AS3583.1	
- Blended Stabilising Agent	1 contract	1 per month		
- Water				
Chloride ion content	1 contract	1 per contract	AS3583.13	
Sulphate ion content	1 contract	1 per contract	AS1289.4.2.1	
Undissolved solids	1 contract	1 per contract		
Mix Design	NATA certification - Supplier's documentary evidence and certification	1 mix	1 per mix	
Stationary Mixing Plant	Application rate of stabilising agent	1 day's production	1 per 100t	
	Compressive strength of product	1 day's production	1 per 400t	AS1289.6.1.1
In-Situ Spreading	Spread rate	1 layer 1,000m ²	1 per lot or 1 per 500m ²	
	Mix uniformity	1 layer 1,000m ²	1 per 500m ²	Visual
Trimming and Compaction	Geometry	1 layer 2,000m ² , max 1 day's placement	One cross section per 25m	Survey
	Surface Quality	"	10 per 200m lane length *	3m Straight Edge
	Average Layer thickness	"	1 per lot	
	Average Width	"	1 per lot	Measure/Survey
	Relative Compaction/Moisture Content	"	3 per lot	AS1289.5.7.1 AS1289.5.8.1

* Note: or part thereof, per lot.

**Sub-Annexure B5
FLEXIBLE PAVEMENTS (Specification C242)**

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Base and Subbase Supply	Material Quality - Supplier's documentary evidence and certification	1 contract		
	- Particle Size Distribution		1 per 1,000t	AS1289.3.6.1
	- Fine Particle Size Distribution Ratio		1 per 1,000t	AS1289.3.6.3
	- Liquid Limit		1 per 1,000t	AS1289.3.1.1
	- Plastic Limit		1 per 1,000t	AS1289.3.3.1
	- Plasticity Index		1 per 1,000t	AS1289.3.3.1
	- Maximum Dry Compressive Strength		1 per 5,000t	T114
	- Particle Shape		1 per 1,000t	AS1141.14
	- Aggregate Wet Strength		1 per 5,000t	AS1141.22
	- Wet/Dry Strength Variation		1 per 5,000t	AS1141.22
	- Modified Texas Triaxial Classification		1 per contract	T171
	- Unconfined Compressive Strength (Modified)		1 per 5,000t	T116
	- Unconfined Compressive Strength (Bound)	1 contract	1 per mix design	T131
	- Water-soluble Sulphate Content (%S by mass)		1 per 1,000t	AS1289.D21
- Total Sulphur Content (%S by mass)		1 per 1,000t	AS1141.36	
Placement	Geometry: Alignment & Level	One layer 2,000m ² or max 1 day's placement	1 Cross Section per 15m	Survey
	Width & Surface Trim		10 per selected 200 lin m*	Measure & 3m Straight Edge
	Deflection Control - Benkelman Beam	One layer 5,000m ² or max 1 day's placement	4 per 1,000m ² minimum 10 per lot	T160
Compaction/Moisture Content/Dry Density Testing	One layer 5,000m ² - max 1 day's placement	10 per 5,000m ² layer or 3 per lot if less	AS1289.5.2.1, T130, AS1289.5.4.1', AS1289.5.8.1	

* Note: or part thereof, per lot.

**Sub-Annexure B6
SPRAYED BITUMINOUS SURFACING (Specification C244)**

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Materials Supply	Material Quality - Suppliers documentary evidence and certification of:			
	- Class 170 Bitumen	1 tanker load	1 per tanker load	AS 2008
	- Refinery Cutback Bitumen	1 tanker load	1 per tanker load	AS 2157
	- Polymer Modified Binder	1 tanker load	1 per tanker load	AS 2341.21
	- Bitumen Adhesion Agent	1 delivery	1 per delivery	
	- Cutback Oils	1 delivery/ tanker	1 per delivery/tanker	AS 2758.2
	- Aggregate Precoating Agent	1 delivery/ tanker	1 per delivery/tanker	
	- Aggregate	1 contract	1 per 400m3	AS2758.2
Application Rates	Binder	1 day's operation	Calculate per spray run	
	Aggregate	1 day's operation	Calculate per spray run	

† One per Contract or change in material

* Note: or part thereof, per lot

**Sub-Annexure B7
ASPHALTIC CONCRETE (Specification C245)**

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Materials Supply	Material Quality - Supplier's documentary evidence and certification of: - Coarse & Fine Aggregates · Grading · Moisture Content · Wet Strength · Wet/Dry Strength Variation · Particle Shape · Fractured Faces · Polishing Agg Friction Value - Mineral Filler - Bitumen Binder - Polymer Modified Bitumen · Elasticity Recovery at 60°C · Viscosity on ER at 60°C · Torsional Recovery at 25°C · Viscosity at 180°C - Bitumen Adhesion Agent · Resistance to Stripping - Reclaimed Asphalt Pavement (RAP) - Bitumen Emulsion	1 week's production 1 week's production 1 contract 1 contract 1 contract 1 contract 1 contract 1 contract 1 contract or 1 month's production 1 refinery batching 1 production batch by supplier 1 contract 1 stockpile 1 contract	1 per day 1 per day)) 1 per) contract) or change in) material contract or 1 per month's production 1 per tanker load 1 per tanker load 1 per contract or change in material 1 per stockpile 1 per contract or change in material	AS2758.5 AS1141.11 AS1289.2.1.1 AS1141.22 AS1141.22 AS1141.14 AS1141.18 AS1141.42 AS2357 AS2008 MBT 21 MBT 21 MBT 22 MBT 11 T230 or nominated equivalent AS1141.11 AS1160
Mix Design - Nominated Mix	Approval of mix and NATA certification. Supplier's documentary evidence and certification	1 mix per contract	1 per mix	
Production Mix	Temperature Moisture Content Grading Binder Content	C245.7 from Spec C245 Asphaltic Concrete as included as separate table below. Additionally, max lot size one 12 hr shift's production.	1 per truck load	Measure AS2891.10 AS2891.3.3 AS2891.3.1
	Resistance to Stripping	1 production mix	1 per mix per 5000t or once per month (whichever is the most frequent)	T640

Laying and Compaction	Temperature	1 day's laying per site	1 per truck load	Measure
	Levels	1 day's laying per site	1 cross section	Survey

QUALITY CONTROL REQUIREMENTS – QUEANBEYAN-PALERANG

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
	Shape	1 day's laying	per 25m 10 per 200m* lane length	3m Straight Edge
	Relative Compaction/Layer Thickness	1 day's laying	6 cores per lot 10 nuclear density tests per lot	AS2891.9.3 or Nuclear Density Meter

* Note: or part thereof, per lot

Quantity of Asphalt in production lot	Minimum Frequency of Testing
Less than 100 tonnes	One per 50 tonnes or part thereof
101 to 300 tonnes	One per 100 tonnes or part thereof
301 to 600 tonnes	One per 150 tonnes or part thereof
Over 600 tonnes	One per 200 tonnes or part thereof

Table C245.7 Minimum Testing Frequencies for Asphalt Production

Sub-Annexure B8
READY-MIXED CONCRETE PRODUCTION & SUPPLY
(Specifications C247, C248)

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Raw Materials Supply	Material Quality - Supplier's documentary evidence and certification of:-			
	Cement	1 month's production	1 per week	AS 3972
	Flyash	1 month's production	1 per month	AS 3582.1
	Water	1 contract	1 per contract	AS3583.13, AS1289.4.2.1
	Admixtures	1 month's production	1 per month	AS 1478
	Fine Aggregates (C248 only)			
	- Grading	1 week's production	1 per 200m ³ concrete*	AS1141.11
	- Moisture Content	N/A	1 per day	
	- Sulphate Soundness	1 contract	1 per contract	AS1141.24
	- Bulk Density	1 contract	1 per contract	AS 2758.1
	- Unit Mass (particle density)	1 contract	1 per contract	AS 2758.1
	- Water Absorption	1 contract	1 per contract	AS 2758.1
	- Material Finer 2µm	1 contract	1 per contract	AS 2758.1
	- Deleterious Material (Impurities/Reactive)	1 contract	1 per contract	AS 2758.1
	- Combined Aggregates (C247 and C248)			
	- Grading	1 week's production	1 per 200m ³ concrete*	AS1141.11
	- Moisture Content	1 week's production	1 per day	
	- Wet Strength	1 contract	1 per contract	AS1141.22
	- Wet/Dry Strength Variations	1 contract	1 per contract	AS1141.22
	- Sulphate Soundness	1 contract	1 per contract	AS1141.24
	- Particle Shape	1 contract	1 per contract	AS1141.14
- Fractured Faces	1 contract	1 per contract	AS1141.18	
- Bulk Density	1 contract	1 per contract	AS 2758.1	
- Unit Mass (particle density)	1 contract	1 per contract	AS 2758.1	
- Water Absorption	1 contract	1 per contract	AS 2758.1	
- Material Finer 75µm	1 contract	1 per contract	AS 2758.1	

QUALITY CONTROL REQUIREMENTS – QUEANBEYAN-PALERANG

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Raw Materials Supply (Cont'd)	- Weak Particles	1 contract	1 per contract	AS 2758.1
	- Light Particles	1 contract	1 per contract	AS 2758.1
	- Deleterious Materials (Impurities/Reactive)	1 contract	1 per contract	AS 2758.1
	- Iron Unsoundness	1 contract	1 per contract	AS 2758.1
	- Falling/Dusting Unsoundness	1 contract	1 per contract	AS 2758.1
Mix Design	Compressive Strength	1 contract mix	1 per mix per contract	AS1012.9
	Aggregate Moisture Content	1 contract mix	1 per mix per contract	
	Consistency - Slump	1 contract mix	1 per mix per contract	AS1012.3.1
	Air Content	1 contract mix	1 per mix per contract	AS1012.4 Method 2
	Shrinkage	1 contract mix	1 per mix per contract	AS1012.13

* Note: or part thereof, per lot

**Sub-Annexure B9
MASS CONCRETE SUBBASE (Specification C247)**

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Concrete Supply	Refer Sub-Annexure B8: Ready-Mixed Concrete Production and Supply			
	Concrete/Air Temperature	50m ³	1 per 50m ³	Measure
	Air Content	50m ³	1 per 50m ³	AS1012.4 Method 2
	Consistency - Slump	50m ³	1 per load	AS1012.3.1
	Compressive Strength (7 day)	50m ³	1 pair per 50m ³	AS1012.1 AS1012.8 AS1012.9
Placement	Compressive Strength (28 day)	50m ³	1 pair per 50m ³	AS1012.1 AS1012.8 AS1012.9
	Thickness	50m ³	5m grid on plan area	Survey and check with subgrade survey
	Geometry	50m ³	1 cross section per 15m	Survey and 3m Straight Edge
Curing	Material Quality - Supplier's documentary evidence and certification	1 contract	1 per production batch	AS3799 AS1160
	Application Rate	1 day's work	1 per 1000m ² *	
Joints	Geometry	50m ³	All joints	Survey

* Note: or part thereof, per lot

**Sub-Annexure B10
PLAIN OR REINFORCED CONCRETE BASE (Specification C248)**

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Concrete Supply	Refer Sub-Annexure B8: Ready-Mixed Concrete Production and Supply			
	Concrete/Air Temperature	50m ³	1 per 50m ³	Measure
	Air Content	50m ³	1 per 50m ³	AS1012.4 Method 2
	Consistency - Slump	50m ³	1 per load	AS1012.3.1
	Compressive Strength (7 day)	50m ³	1 pair per 50m ³	AS1012.1 AS1012.8 AS1012.9
	Compressive Strength (28 day)	50m ³	1 pair per 50m ³	AS1012.1 AS1012.8 AS1012.9
Placement	Relative Compaction			
	- Machine Placed	50m ³	1 per 50m ³ *	AS1012.14
	- Hand Placed	Area between 2 consecutive construction joints or 50m ³ (whichever is the lesser)	2 per lot	AS1012.14
	Thickness	50m ³	5m grid on plan area	Survey
	Geometry	50m ³	1 cross section per 15m	Survey and 3m Straight Edge
Ride Quality	Profile Factor	1000m ²	10/lane/lot	3m Straight Edge
Surface Texture	Texture Depth	1000m ²	2 per lot	Survey
Curing	Material Quality - Supplier's documentary evidence and certification	1 contract	1 per production batch	AS3799 AS1160
	Application Rate	1 day's work	1 per 1000m ² *	
Joints	Sealant Material Quality Supplier's documentary evidence and certification	1 contract	1 per production batch	
	Geometry	50m ³	All joints	Survey

* Note: or part thereof, per lot

**Sub-Annexure B11
BITUMINOUS MICROSURFACING (Specification C255)**

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Materials Supply	Material Quality - Supplier's documentary evidence and certification of:			
	- Bitumen (prior to emulsification)	1 contract	1 per contract or change in material	AS2008
	- Bitumen Emulsion · Residual Binder Content (Residue from Evaporation)	1 contract	2 per bulk delivery	AS1160, App.D
	- Mineral Aggregates · Degradation Factor	1 contract	1 per contract or 6 month period	AS1141.25
	· Los Angeles Value	1 contract	"	AS1141.23
	· Aggregate Wet Strength	1 contract	"	AS1141.22
	· Wet/Dry Strength Variation	1 contract	"	AS1141.22
	· Polished Aggregate Friction Value	1 contract	"	AS1141.42
	· Sand Equivalent	1 contract	"	AS1289.3.7.1
	- Mineral Filler	1 month's production	"	AS2357
- Combined Aggregate Grading	1 contract	"	AS1141.11, AS1141.12	
Mix Design - Nominated Mix	Approval of mix and NATA certification - Supplier's documentary evidence and certification	1 contract	1 per mix	
Production Mix	Grading	1 day's production or 50m ³ (whichever is the lesser)	2 per 50m ³ *	AS2891.3.1
	Residual Binder Content		2 per 50m ³ *	AS2891.3.1
Laying	Levels	1 layer, max 200m ³	1 cross section per 15m	Survey
	Surface Quality	1 layer, max 200m ³	10 per 100m* lane length	3m Straight Edge

* Note: or part thereof, per lot

**Sub-Annexure B12
SEGMENTAL PAVING (Specification C254)**

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Materials Supply	Material Quality - Supplier's documentary evidence and certification of:			
	- Concrete Segmental Paving Units	1 contract	1 per contract	
	- Clay Segmental Paving Units	1 contract	1 per contract	
	- Bedding Sand · Grading	1 contract	1 per contract or change in material	AS1141.11
	- Joint Filling Sand · Grading	1 contract	1 per contract or change in material	AS1141.11
Base	Geometry	One layer 5000m ² , max 1 day's placement	One cross section per 25m	Survey
	Surface Quality	"	10 per 200m ² or lot	3m Straight Edge
Edge Restraints	Refer 'Minor Concrete Works'	1 day's placement	1 per 10 lin m	Measure/Survey
Laying Paver Units	Joint Width	1 day's placement	All joints	Measure
	Geometry	1 day's placement	One cross section per 15m	Survey
	Surface Quality	1 day's placement	10 per 200m ² or lot	3m Straight Edge

* Note: or part thereof, per lot

**Sub-Annexure B13
MINOR CONCRETE WORKS (Specification C271)**

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Subgrade	Compaction	1000 lin m or 1000m ²	1 per 200 lin m or 200m ²	AS1289.5.4.1
Gravel Subbase Construction	Compaction	1 day's placement	1 per 100 lin m or 100m ²	AS1289.5.4.1
	Subbase Geometry	1 day's placement	1 per 25 lin m	3m Straight Edge
Steel Supply	Material Quality - Suppliers documentary evidence and certification	1 delivery	1 per production batch	
Ready-Mixed Concrete Supply	Material Quality - Suppliers documentary evidence and certification	1 contract	1 per mix type	
	Consistency - Slump	15m ³	1 per load	AS1012.3 Method 1
	Compressive Strength (7 and 28 day)	15m ³	2 pairs per 15m ³	AS1012.1, AS1012.8, AS1012.9
Concrete Placement	Finished Levels	15m ³	1 cross section per 15m	Survey and 3m Straight Edge
	Surface Dimensions	Single Fabrication	As required to confirm design dimensions	measure
Backfilling	Material Quality			
	- Maximum particle size	1 contract/ material type	1 per 200m ³ or lot	
	- Plasticity Index	1 contract/ material type	1 per 200m ³ or lot	AS1289.3.3.1
	Compaction	1 day's work or max 200m ²	1 per 200m ² or lot	AS1289.5.4.1
Sprayed Concrete	Test Panels and Cores	1 contract	3 test panels and 4 cores per mix design	AS1012.4, AS1012.9 AS1012.14
	Compressive Strength Cores	15m ³	2 per 15m ³	AS1012.4, AS1012.9 AS1012.14
	Curing Material Quality - Supplier's documentary evidence and certification	1 contract	1 per production batch	

* Note: or part thereof, per lot

**Sub-Annexure B14
PAVEMENT MARKINGS (Specification C261)**

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Materials Supply	Material Quality - Supplier's documentary evidence and certification of:			
	- Paint	1 contract	1 per contract or change in material	
	- Glass Beads	1 contract	"	
	- Thermoplastic Material	1 contract	"	
	- Raised Pavement Markers	1 contract	"	
Paint Application	Wet Film Thickness	1 contract	1 per site visit or change in pressure settings	AS 1580.107.3
	Application Rate of Glass Beads	1 contract	1 per site visit or change in pressure settings	Annexure C261-A
Thermoplastic Application	Cold Film Thickness	1 contract	1 per site visit or change in pressure settings	Measure by micrometer
	Application Rate of Glass Beads	1 contract	1 per site visit or change in pressure settings	Annexure C261-A

**Sub-Annexure B15
SIGNPOSTING (Specification C262)**

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Materials Supply	Material Quality - Supplier's documentary evidence and certification of:			
	- Sign Blanks	1 contract	1 per contract, or change in material	AS 1743
	- Aluminium Extrusion Backing	1 contract	"	AS 1866
	- Retro-reflective Material	1 contract	"	AS 1743
	- Non-reflective Paint	1 contract	"	
	- Non-reflective Sheet Material	1 contract	"	
	- Steel Sign Support Structures			
- Grade	1 contract		AS 1627.9	
- Protective Treatment	1 contract		AS 4680 & AS 1214	
Concrete Foundations	Refer 'Minor Concrete Works'			

**Sub-Annexure B16
LANDSCAPING (Specification C273)**

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Seed	Certification of Authenticity for the prescribed Mix	1 contract	Certification for each production batch delivered	
Imported Topsoil	Material Quality			AS4419
	- pH	10,000m ²	1 per 500m ³ *	
	- Organic Content	10,000m ²	1 per 500m ³ *	
	- Soluble Salt Content	10,000m ²	1 per 500m ³ *	
Mulch for Planting	Material Quality	1 contract	1 contract	AS4454

* Note: or part thereof, per lot.

**Sub-Annexure B17
WATER RETICULATION (Specification C401)**

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Materials Supply	Material Quality - Supplier's documentary evidence and certification of:			
	- PVC-M Pipes	1 contract	1 per contract	AS/NZS 4765
	- PVC-O Pipes	1 contract	1 per contract	AS/NZS 4765
	- Ductile Iron Cement Lined (DICTL) Pipes	1 contract	"	AS/NZS 2280 and AS2129
	- Steel Pipes	1 contract	1 per contract	AS 1579 and AS/NZS 1594
	- Copper Pipe	1 contract	"	AS1432
	- Polyethylene Pipe	1 contract	"	AS/NZS 4130
	- Stop Valves Material	1 contract	"	AS2638 and AS2129
- Non Return Valves	1 contract	"	AS3578	
- Spring Hydrants	1 contract	1 per contract	AS2544 or AS3952	
Siting and Excavation	Geometry	1 line	1 per line	Survey
Bedding	Material Quality - Grading	1 contract	1 per contract per source	AS/NZS 2032
Thrust and Anchor Blocks	Refer Sub-Annexure B13			
Concrete Encasement	Refer Sub-Annexure B13			
Chamber Covers and Frames	Geometry	1 cover/frame	1 per cover/frame	survey
Testing of Pipelines	Pressure testing	1 line	1 per line	As specified C401.28
Backfill and Compaction	Compaction	1 line	1 per 2 layers max 100m ²	AS1289.5.7.1
Switchgear and Controlgear Assembly	Electrical function	each installation	1 factory test per installation	AS3439
Commissioning of Pumping Station	Certification testing of electrical installation in accordance with relevant Australian Standards	1 installation	1 per installation	

**Sub-Annexure B18
SEWERAGE SYSTEM (Specification C402)**

ACTIVITY	KEY QUALITY VERIFICATION REQUIREMENTS	MAXIMUM LOT SIZE	MINIMUM TEST FREQUENCY	TEST METHOD
Materials Supply	Material Quality - Supplier's documentary evidence and certification of:			
	- PVC-U Pipes	1 contract	1 per contract	AS/NZS 1260
	Polypropylene (PP) Pipes	1 contract	"	AS/NZS 5065
	- Ductile Iron Cement Lined (DICL) Pipes	1 contract	"	AS2280 and AS2129
	- Steel Pipes	1 contract	"	AS/NZS 2280
	- Vitrified Clay Pipes	1 contract	"	AS1741
	- Precast Access Chambers	1 contract	"	AS/NZS 1477, AS 2033 or AS4198
Siting and Excavation	Geometry	1 line/ structure	1 per line/ structure	Survey
Bedding	Material Quality - Grading	1 contract	1 per contract per source	AS1152
Concrete Bedding	Refer Sub-Annexure B13			
Laying and Jointing of Pipes, Access Chambers, Structures	Geometry	1 line	1 per line	Survey
Thrust and Anchor Blocks	Refer Sub-Annexure B13			
Concrete Encasement	Refer Sub-Annexure B13			
Cast-in-situ Access Chambers	Material Quality - Tri-Calcium Aluminate Content	1 contract	1 per contract per source	AS3972
	- Fineness Index	1 contract	"	AS3972
	- Minimum Cement Content	1 contract	"	AS3972
Acceptance Test of Gravitation Mains and Access Chambers	- Compressed Air Testing	1 line	1 per line	As specified C402.36 C402.37
	- Hydrostatic Testing	1 per test length Test length = 1370m pipeline dia.(mm)	1 per line	As specified C402.38
Backfill and Compaction	Compaction	1 line	1 per 2 layers max 100m ²	AS1289.5.7.1
Switchgear and Controlgear Assembly	Electrical Compliance	each installation	1 factory test per installation	AS3439
Commissioning of Pumping Station	Certification testing of electrical installation in accordance with relevant Australian Standards	1 installation	1 per installation	

QUALITY CONTROL REQUIREMENTS – QUEANBEYAN-PALERANG

Check List

MAXIMUM LOT SIZE AND MINIMUM TEST FREQUENCIES

		Check Completed By (initials)	Date	Not Applicable (tick)
1	Earthworks (Sub-Annexure B1)	_____	____ / ____ / ____	<input type="checkbox"/>
2	Stormwater Drainage (Sub-Annexure B2) -Pipe Culverts, Box Culverts, Open Drains including Kerb and Gutter, Drainage Structures.	_____	____ / ____ / ____	<input type="checkbox"/>
3	Subsurface Drainage (Sub-Annexure B3)	_____	____ / ____ / ____	<input type="checkbox"/>
4	Stabilisation (Sub-Annexure B4)	_____	____ / ____ / ____	<input type="checkbox"/>
5	Flexible Pavements (Sub-Annexure B5)	_____	____ / ____ / ____	<input type="checkbox"/>
6	Spayed Bituminous Surfacing (Sub-Annexure B6)	_____	____ / ____ / ____	<input type="checkbox"/>
7	Asphaltic Concrete (Sub-Annexure B7)	_____	____ / ____ / ____	<input type="checkbox"/>
8	Ready Mixed Concrete Production and Supply (Sub-Annexure B8)	_____	____ / ____ / ____	<input type="checkbox"/>
9	Mass Concrete Subbase (Sub-Annexure B9)	_____	____ / ____ / ____	<input type="checkbox"/>
10	Plain or Reinforced Concrete Base (Sub-Annexure B10)	_____	____ / ____ / ____	<input type="checkbox"/>
11	Bituminous Microsurfacing (Sub-Annexure B11)	_____	____ / ____ / ____	<input type="checkbox"/>
12	Segmental Paving (Sub-Annexure B12)	_____	____ / ____ / ____	<input type="checkbox"/>
13	Minor Concrete Works (Sub-Annexure B13)	_____	____ / ____ / ____	<input type="checkbox"/>
14	Pavement Markings (Sub-Annexure B14)	_____	____ / ____ / ____	<input type="checkbox"/>
15	Signposting (Sub-Annexure B15)	_____	____ / ____ / ____	<input type="checkbox"/>
16	Landscaping (Sub-Annexure B16)	_____	____ / ____ / ____	<input type="checkbox"/>
17	Water Reticulation (Sub-Annexure B17)	_____	____ / ____ / ____	<input type="checkbox"/>
18	Sewerage System (Sub-Annexure B18)	_____	____ / ____ / ____	<input type="checkbox"/>

ANNEXURE CQC-D

QUEANBEYAN PALERANG REGIONAL COUNCIL

ENGINEER'S CONSTRUCTION CERTIFICATION

(To be completed by the Developer's Supervising Engineer)

Project Title: _____

Property Details (Lot/DP): _____

DA No: / CDC No: _____

Name of Developer's Engineer: _____

Name and Address of Developer: _____

I certify that the construction works associated with the above mentioned development have been carried out in accordance with current standards of good industry practice and in accordance with the approved engineering design plans and the technical specification.

I certify that the completed works are in strict accordance with the development consent conditions and where a variance to the consent is found, written confirmation has been received from Council approving the variance prior to the commencement of construction.

I certify that the works as executed documentation provides an accurate representation of the constructed works and where a variation has occurred from the approved drawing the works as executed documentation clearly reflects the variation.

Engineer/Surveyor Date

Qualifications

Contact Phone: _____

Contact Postal Address: _____
